


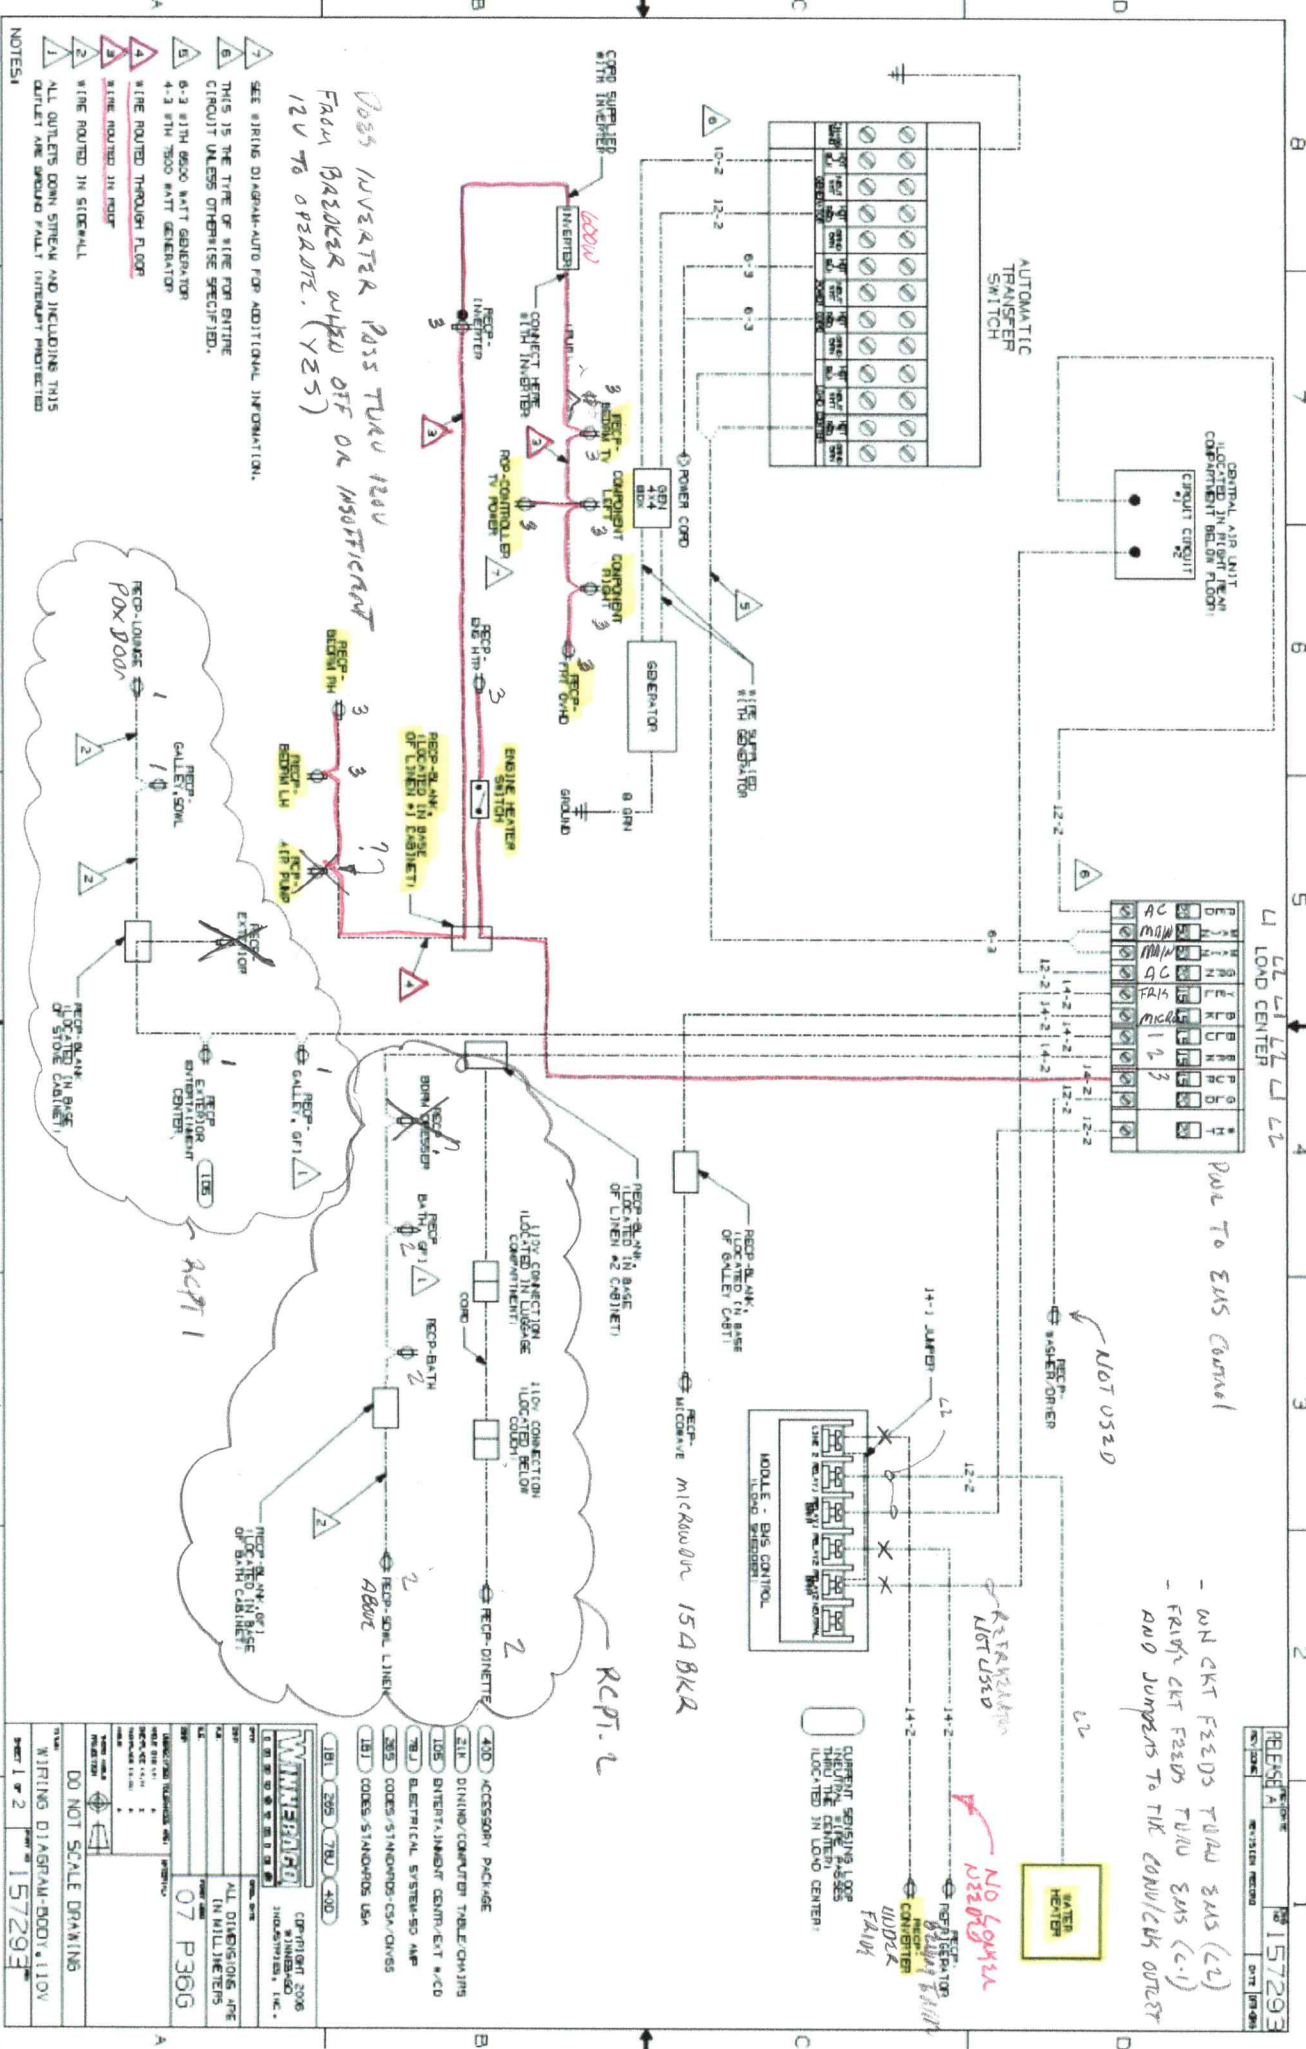

CKT 3 SUBSTATION UNIT ONLY
 CKT 2 MAIN DATA/SUBSTATION
 CKT 1 COMPUTER SUBSTATION
 MICROWAVE

- ON CKT F230S TUBS (L2)
 - FROM CKT F230S TUBS (L2-1)
 AND JUMPS TO THE CORNERS OUTLET

WIRE TO EAS CONTROL

NOT USED

NO 60414

WATER HEATER

MODULE - BUS CONTROL

REC'D BATH, BASE OF GALLEY CABINET

REC'D MICROWAVE

LOC. CONNECTION LOCATED IN LUGGAGE COUCH

REC'D DINETTE

REC'D BATH, BASE OF BATH CABINET

REC'D BATH, BASE OF BATH CABINET

REC'D BATH, BASE OF GALLEY CABINET

REC'D BATH, BASE OF GALLEY CABINET

REC'D BATH, BASE OF GALLEY CABINET

REC'D BATH, BASE OF GALLEY CABINET

REC'D BATH, BASE OF GALLEY CABINET

REC'D BATH, BASE OF GALLEY CABINET